


# Central East Transfer-out (CETO) Transmission Development 2<sup>nd</sup> Reaffirmation Study Report

**APEGA**  
Permit-to-Practice  
P-8200

*Alta*  
Nov 9, 2022

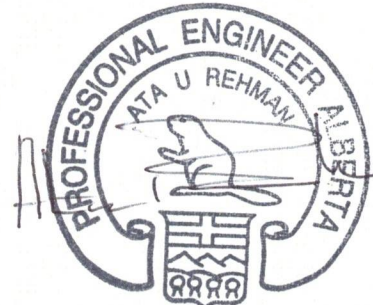

*Alta*  
Nov 9, 2022

Role	Name	Date	Signature
Prepared	Asef Mustakim, E.I.T.	9 <sup>th</sup> November, 2022	Asef Mustakim
	Fizzah Malik, E.I.T.	November 9, 2022	<i>Fizzah</i>
Reviewed	Peter Huang, P. Eng.	November 9, 2022	<i>Alta Rehman</i>
Approved	Alta Rehman P. Eng.	November 9, 2022	<i>Alta Rehman</i>

*for*

## Table of Contents

<b>1. Introduction</b>	<b>1</b>
<b>2. Modeling and Assumptions</b>	<b>3</b>
2.1. Load Assumptions	3
2.1.1. Forecast Load	3
2.2. Generation Assumptions	4
2.2.1. Renewable Generation	5
2.2.2. Major Thermal Generation in the Study Area	5
2.2.3. Projects that Met the AESO's Project Inclusion Criteria	5
2.3. Transmission System Assumptions	6
2.3.1. Contingencies	6
2.3.2. Monitored Transmission Lines and Ratings	8
2.3.3. HVDC Dispatch	9
2.4. Study Scenarios	9
<b>3. Reaffirmation Study Results</b>	<b>9</b>
<b>4. Conclusion</b>	<b>10</b>

## 1. Introduction

The AESO's Needs Identification Document (NID) and the transmission facility owners' Facility Applications (FA) for the Central East Transfer-out (CETO) Transmission Development were approved by the Alberta Utilities Commission in August, 2021. As part of the approved CETO NID, the AESO determined it to be appropriate to specify construction milestones, in accordance with Subsection 11(4) of the *Transmission Regulation*, for the construction and energization of each stage of the Preferred Transmission Development. The construction milestone monitoring process enables the AESO to manage uncertainty regarding the timing and impacts of generation development in the CETO Study Area.<sup>1</sup>

The AESO has been monitoring generation development in the CETO Study Area as incremental generation meets the AESO's project inclusion criteria.<sup>2</sup> Once incremental generation is within the milestone monitoring range, the AESO will reaffirm that congestion is forecast to occur greater than 0.5% of the time annually during the N-0 system condition by performing congestion assessment studies that take into account the locations and sizes of the generation meeting the certainty criteria. This study reaffirms that N-0 congestion is forecast to occur greater than 0.5% of the time annually, resulting in the Stage 1 construction milestone being met. The reaffirmation study process is shown in Figure 1.

---

<sup>1</sup> The CETO Study Area and the Study Area used for this report, are defined in Section 2.0.

<sup>2</sup> The AESO's project inclusion criteria are available in *ID #2018-018T Provision of System Access Service and the AESO Connection Process*, on the AESO website.

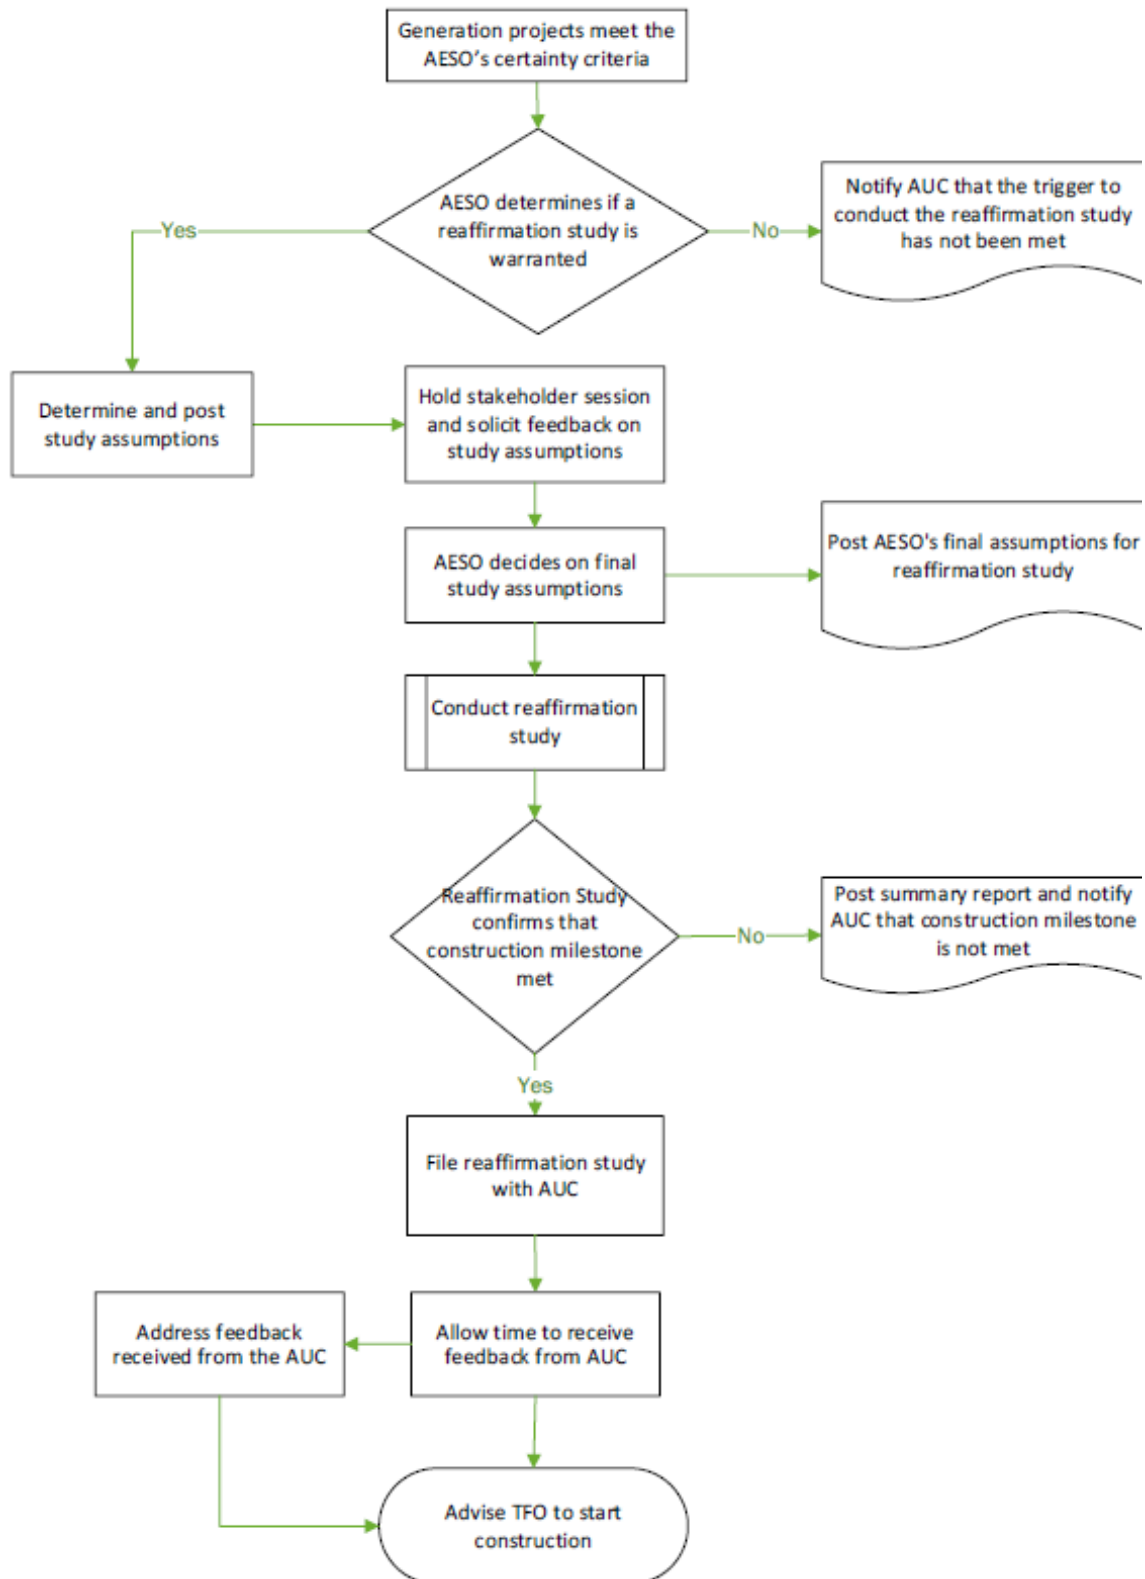


Figure 1: Reaffirmation Study Process

In October, 2021, approximately 1,700 MW of new generation above the existing generation of 2,321 MW that was measured in January, 2020 for the CETO NID, had met the AESO's project inclusion criteria in the CETO Study Area, for a total of approximately 4,021 MW. This 1,700 MW of new generation was above the upper range of the CETO milestone monitoring range of 1,050 MW to 1,550 MW, as identified in the CETO NID. Therefore, a reaffirmation study was performed in the first quarter of 2022 to determine if there was sufficient congestion to trigger the CETO Stage 1 construction milestone. The results of the study indicated that those projects were not enough to trigger the CETO Stage 1 construction milestone at that time.

As more generation projects in the Central and South Planning Regions<sup>3</sup> met the AESO's project inclusion criteria between the end of January, 2022 and the end of August, 2022<sup>4</sup>, the AESO initiated a second reaffirmation study to determine if the CETO Stage 1 construction milestone needs to be triggered. This Reaffirmation Study Report documents the methodology, assumptions, and results of the second reaffirmation study.

## 2. Modeling and Assumptions

The reaffirmation study was performed for the full year of 2026 to identify the potential risks of congestion. Year 2026 was selected since the anticipated in-service date for the CETO project, if construction is triggered by the end of 2022, would be in the year 2026.

The Study Area in this study is consistent with the Study Area in the CETO NID and consists of the Central east (CE) and Southeast (SE) sub-regions, which comprise of the following AESO planning areas:

CE sub-region: Lloydminster (Area 13), Wainwright (Area 32), Alliance/Battle River (Area 36), Provost (Area 37), Hanna (Area 42) and Vegreville (Area 56).

SE sub-region: Medicine Hat (Area 4), Sheerness (Area 43), Brooks (Area 47), Empress (Area 48) and Vauxhall (Area 52).

### 2.1. Load Assumptions

The following subsections describe the AESO's current outlook for load in the Study Area.

#### 2.1.1. Forecast Load

The load forecast used in the reaffirmation study covers the latest information in the Study Area and was based on the AESO's *2021 Long-term Outlook*<sup>5</sup> (2021 LTO) Reference Case. The Reference Case load forecast represents the AESO's current expectations for long-term load growth given uncertainties facing the electricity industry. Using econometric models, the 2021 LTO provides hourly load forecasts at Alberta internal load (AIL), AESO Planning Region, AESO planning area, and Point of Delivery (POD) levels for the

---


<sup>3</sup> The AESO Planning Regions map is available on the AESO website.

<sup>4</sup> The AESO's Project List is available on the AESO website.

<sup>5</sup> The 2021 LTO is available on the AESO website.

next 20 years.<sup>6</sup> The duration curve of the 2026 load used in the study is shown in Figure 2 and the minimum, average, and maximum load are shown in Table 1.

The reaffirmation study simulations used the weather-synchronized hourly POD level load forecasts for all the substations in the Alberta interconnected electric system (AIES). This approach captures the localized hourly load patterns and how this load diversity impacts the transmission system power flows.

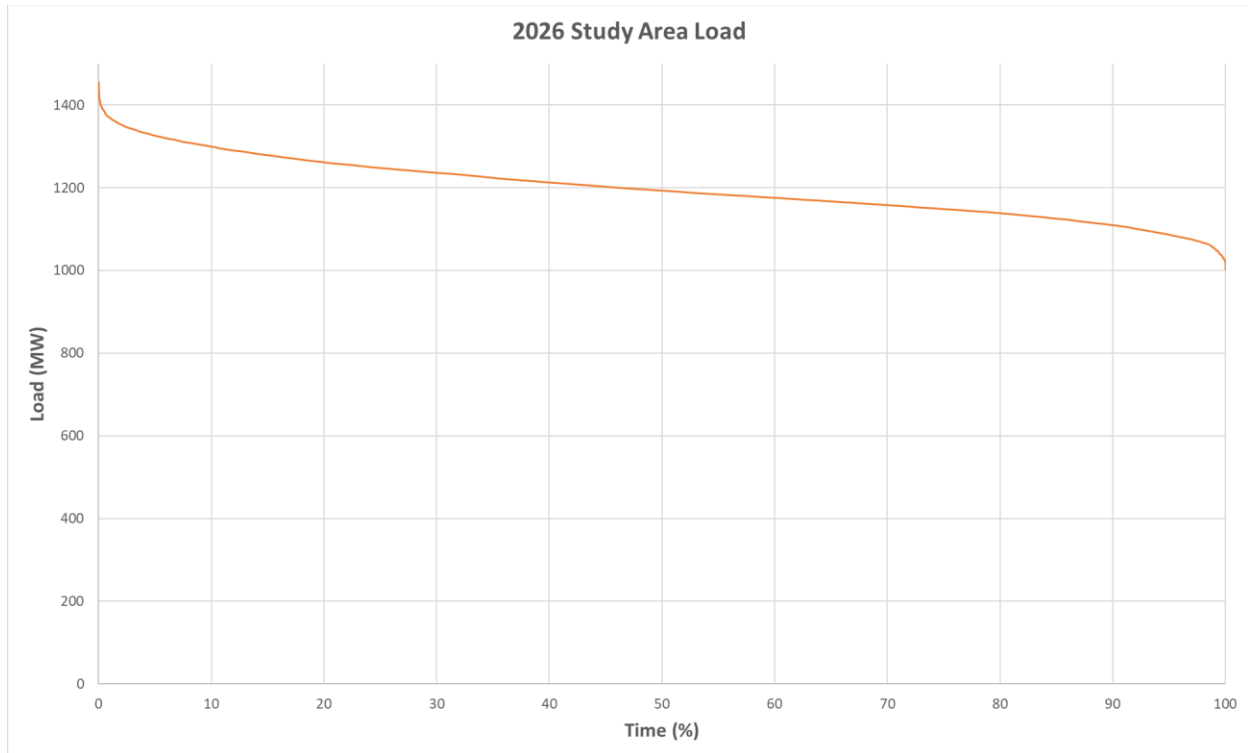

**Figure 2: 2026 Study Area Load**

**Table 1 – Forecast Load in the Study Area for Year 2026**

Minimum (MW)	Average (MW)	Maximum (MW)
1,003	1,200	1,456

## 2.2. Generation Assumptions

The forecast average natural gas price and carbon price for the year 2026 were \$4.16/GJ and \$110/ton. All other key generation assumptions used in this reaffirmation study are described in the sections below.

<sup>6</sup> Please refer to the 2021 LTO, available on the AESO website, for more details on forecast methodology.

### 2.2.1. Renewable Generation

Table 2 below shows the aggregate maximum capacity of renewable generation in the Study Area.

**Table 2 – Aggregate Maximum Capacity of Renewable Generation in the Study Area**

Renewable Generation Capacity in Main Scenario (as of end of Aug 2022)	MW
In Service	1,487
CE Incremental (met project inclusion criteria)	1,120
SE Incremental (met project inclusion criteria)	2,316
<b>Study Area Total</b>	<b>4,923</b>

Maximum capacity of renewable generation in the Southwest (SW) sub-region as of the end of August, 2022 was 2,370 MW (2,100 MW existing generation and 270 MW based on projects that met the AESO’s project inclusion criteria). The SW sub-region is outside the Study Area and its generation information is only included here as a reference.

### 2.2.2. Major Thermal Generation in the Study Area

Table 3 below lists the major thermal generators in the Study Area that were included in the reaffirmation study.

**Table 3 – Major Thermal Generators in the Study Area**

Asset	Type	Maximum Capability (MW)	Subregion
Battle River #4 (BR4)	Coal to Gas	155	CE
Battle River #5 (BR5)	Coal to Gas	385	CE
Sheerness #1 (SH1)	Coal to Gas	400	SE
Sheerness #2 (SH2)	Coal to Gas	400	SE

### 2.2.3. Projects that Met the AESO’s Project Inclusion Criteria

Generation projects in the Study Area that met the AESO’s project inclusion criteria as of the end of August, 2022 were included in the studies. Table 4 below lists the projects in the Study Area that were included in the studies.

**Table 4 – Projects in the Study Area that Met the AESO’s Project Inclusion Criteria**

Project Name	Type	Maximum Capability (MW)	Planning Area
P1250 Wild Run Grizzly Bear Wind	Wind	120	13-Lloydminster
P1567 EDPR Sharp Hills Wind Farm	Wind	300	42-Hanna
P1704 Paintearth Wind Power	Wind	150	42-Hanna
P1898 Pattern Lanfine North Wind	Wind	145	42-Hanna
P1909 Garden Plain Wind	Wind	130	42-Hanna







953L/9L953	240
966L/9L966	240
1034L	240
1035L	240
1047L	240
1051L	240
1052L	240
1053L	240
1075L	240
1087L	240
1088L	240
EATL	500
WATL	500

### 2.3.2. Monitored Transmission Lines and Ratings

Six key transmission lines in the CE sub-region were monitored in this reaffirmation study. The normal ratings for the monitored transmission lines are listed in **Error! Reference source not found.**<sup>6</sup> The software used to perform the reaffirmation study, AURORA, uses a linearized DC model for power flow calculations which assumes a voltage of 1 p.u. at each bus. The thermal ratings of the transmission lines were adjusted accordingly. The ratings were converted from MVA to MW using a power factor of 0.95 to account for the capacity that might be used for reactive power flow.

**Table 6 – Ratings of Monitored Transmission Lines**

Transmission Line	Substation 1	Substation 2	Voltage Class (kV)	Summer Rating (MVA)	Winter Rating (MVA)
912L	Red Deer 63S	Nevis 766S	240	507	624
9L20	Cordel 755S	Nevis 766S	240	489 <sup>7</sup>	540
174L	North Holden 395S	Bardo 197S	138	120	145
701L	North Holden 395S	Strome 223S	138	119	146
7L701	Battle River 757S	Strome 223S	138	142	192

<sup>7</sup> Transmission Capital Maintenance (TCM) works required. The AESO will be engaging ATCO as the Transmission Facility Owner to coordinate the required maintenance work.

9L16	Tinchebray 972S	Cordel 755S	240	499	499
------	--------------------	-------------	-----	-----	-----

### 2.3.3. HVDC Dispatch

The high voltage direct current (HVDC) transmission lines called Western Alberta Transmission Line (WATL) and Eastern Alberta Transmission Line (EATL), were dispatched to minimize transmission system losses in the reaffirmation study. A formula that estimates the minimum loss dispatch based on flows measured on certain alternating current transmission lines was used to determine the HVDC dispatch that should be used for each hour in the simulation.

## 2.4. Study Scenarios

The main scenario of the reaffirmation study was based on the assumptions stated in Sections 2.1 – 2.3. However, to consider the uncertainties of the future, additional sensitivity studies were performed by considering retirement of the following major thermal generators in the Study Area: Battle River #4 (BR4), Battle River #5 (BR5), Sheerness #1 (SH1), and Sheerness #2 (SH2). An additional study was also performed by assuming the CETO project is in service to verify the effectiveness of CETO to relieve congestion. The table below lists the scenarios studied.

**Table 7 – Study Scenarios**

Scenario	BR4	BR5	SH1	SH2	CETO
<b>Main Scenario</b>	In Service	In Service	In Service	In Service	Out of Service
<b>Sensitivity 1</b>	Out of Service	Out of Service	Out of Service	Out of Service	Out of Service
<b>Sensitivity 2</b>	In Service	In Service	In Service	In Service	In Service

## 3. Reaffirmation Study Results

The nodal simulations for each scenario were run as if there were no transmission system constraints. Congestion statistics were then calculated using the transmission line ratings shown in Table 6 of Section 2.3.2. Congestion statistics were calculated for both N-0 and N-1 system conditions based on the contingencies shown in Table 5 of Section 2.3.1. Under N-0, the system must be able to operate congestion free without needing to curtail generation. As such, any hour where flow on lines exceed their thermal ratings is a congested hour. Generation curtailment is allowed post contingency up to the Most Severe Single Contingency (MSSC) value of 466 MW. Thus, an hour under N-1 conditions is considered a congested hour if it requires curtailment greater than 466 MW in order to mitigate line overloads as generation would need to be curtailed pre-contingency (N-0 condition) to avoid curtailing more than 466 MW post-contingency.

While calculating N-1 congestion, dispatch of recently energized generation and generation projects that met the AESO’s project inclusion criteria was allowed to be curtailed up to 466 MW via Remedial Action Scheme (RAS) to mitigate overloads on any of the monitored elements mentioned in Table 6 of Section

2.3.2. Hours where the amount of generation curtailment required to mitigate overloads under contingency conditions exceeded the MSSC value of 466 MW were considered and included as hours with congestion. For N-0, generation was not curtailed and any hour with a line overload was included as a congested hour.

Table 8 below presents the congestion results for all the monitored transmission lines in the Study Area. The table shows the percentage of congested hours expected in 2026 for the scenarios listed in Table 7 of Section 2.4 under both N-0 and N-1 system conditions.

**Table 8 – Reaffirmation Study Results**

Scenario	Annual Congestion (% of Hours)	
	N-0	N-0 & N-1 with RAS
Main Scenario	1.9	2.6
Sensitivity 1	1.4	1.9
Sensitivity 2	0.0	0.0

The results in Table 8 show that both N-0 and N-1 congestion would exceed the AESO’s annual threshold of 0.5% of hours for the Main Scenario. This indicates that without CETO, the AESO anticipates congestion that is higher than the established 0.5% trigger threshold. Similarly, the anticipated congestion under Sensitivity 1, where the two major thermal generation facilities of Battle River and Sheerness were assumed to be out of service, is also above the 0.5% trigger threshold.

Sensitivity 2, where the CETO project was included as part of the model, was also completed to verify the effectiveness of the project in relieving congestion. As the results indicate, no congestion is observed with CETO in service.

## 4. Conclusion

The results of the Main Scenario of this reaffirmation study show that the anticipated congestion in the Study Area would exceed the 0.5% trigger threshold without the CETO transmission development. Furthermore, the results of the Sensitivity 1 scenario indicate that even if the two thermal generators in the Study Area (Battle River & Sheerness) are out of service, congestion would still exceed the 0.5% trigger threshold in 2026.

These results indicate that with generation projects that have met the AESO’s project inclusion criteria, congestion will exceed the AESO’s annual threshold of 0.5%. Therefore, the CETO Stage 1 construction milestone has been met to relieve the anticipated congestion. The results of the Sensitivity 2 scenario confirm that CETO is an effective solution in relieving the anticipated congestion.